



**California Environmental Protection Agency
Department of Toxic Substances Control**

HAZARDOUS WASTE FACILITY PERMIT

Permit Number: 07-SAC-06

Facility Name: Safety-Kleen Systems, Inc.
El Monte Accumulation Center
10625 Hickson Street
El Monte, California 91731

Owner Name: Safety-Kleen Systems, Inc.
5400 Legacy Drive, Cluster II, Building 3
Plano, Texas 75024

Operator Name: Safety-Kleen Systems, Inc.
5400 Legacy Drive, Cluster II, Building 3
Plano, Texas 75024

Facility EPA ID Number:

Effective Date:

Expiration Date:

Pursuant to California Health and Safety Code section 25200, this Resource Conservation and Recovery Act (RCRA)-equivalent Hazardous Waste Facility Permit is hereby issued to: Safety-Kleen Systems, Inc., El Monte Accumulation Center, Los Angeles County, California. The Issuance of this Permit is subject to the terms and conditions set forth in Attachment A and the Part "B" Application (Operation Plan) dated February 2006. The Attachment A consists of 18 pages.

Raymond Leclerc, P.E., Team Leader
Permit Renewal Team
Department of Toxic Substances Control
Date

**SAFETY-KLEEN SYSTEMS, INC.
EL MONTE ACCUMULATION CENTER
LOS ANGELES COUNTY, CALIFORNIA
EPA IDENTIFICATION NUMBER CAT000613893
HAZARDOUS WASTE FACILITY PERMIT**

ATTACHMENT "A"

TABLE OF CONTENTS

| | |
|---|-----------|
| PART I. DEFINITIONS | 2 |
| PART II. DESCRIPTION OF THE FACILITY AND OWNERSHIP | 3 |
| 1. OWNER OF FACILITY | 3 |
| 2. OWNER OF REAL PROPERTY | 3 |
| 3. OPERATOR OF FACILITY | 3 |
| 4. LOCATION | 3 |
| 5. DESCRIPTION OF FACILITY OPERATIONS | 3 |
| 6. FACILITY HISTORY | 4 |
| 7. FACILITY SIZE AND TYPE FOR FEE PURPOSES | 4 |
| PART III. GENERAL CONDITIONS | 5 |
| 1. PERMIT APPLICATION DOCUMENTS | 5 |
| 2. EFFECT OF PERMIT | 5 |
| 3. COMPLIANCE WITH CALIFORNIA ENVIRONMENTAL QUALITY ACT (CEQA) | 6 |
| 4. ENVIRONMENTAL MONITORING | 6 |
| 5. ANNUAL HAZARDOUS WASTE REDUCTION AND MINIMIZATION CERTIFICATION | 6 |
| 6. ACCESS | 6 |
| PART IV. PERMITTED UNITS AND ACTIVITIES | 8 |
| PART V. SPECIAL ONDITIONS | 17 |
| PART VI. CORRECTIVE ACTION | 18 |

PART I. DEFINITIONS

All terms used in this Permit shall have the same meaning as those terms have in the California Health and Safety Code, division 20, chapter 6.5 and California Code of Regulations, title 22, division 4.5, unless expressly provided otherwise by this Permit.

1. **“DTSC”** as used in this Permit means the California Department of Toxic Substances Control.
2. **“Facility”** as used in this Permit means all contiguous land and structures, other appurtenances, and improvements on the land used for the treatment, transfer, storage resource recovery, disposal or recycling of hazardous waste.

A hazardous waste facility may consist of one or more treatment, transfer, storage, resource recovery, disposal or recycling operational units or combinations of these units.

For the purpose of implementing corrective action under California Code of Regulations, title 22, division 4.5, a hazardous waste facility includes all contiguous property under the control of the owner or operator required to implement corrective action.

3. **“Permittee”** as used in this Permit means the Owner and Operator.
4. **“RCRA”** as used in this Permit means the Resource Conservation and Recovery Act (42 U.S.C. §6901 et seq.).

PART II. DESCRIPTION OF THE FACILITY AND OWNERSHIP

1. Owner of Facility

Safety-Kleen Systems, Inc.
5400 Legacy Drive, Cluster II, Building 3
Plano, Texas 75024

2. Owner of Real Property

Columbia Development, LLC.
8075 West Third Street, Suite 302
Los Angeles, California 90048

3. Operator of Facility

Safety-Kleen Systems, Inc.
El Monte Accumulation Center
10625 Hickson Street
El Monte, California 91731

4. Location

Safety-Kleen Systems, Inc., El Monte Accumulation Center (Facility) is located 0.8 miles north of the Interstate Route 10 and 0.6 miles east of Baldwin Avenue in El Monte, Los Angeles County, at the corner of Hickson Street and Esto Avenue.

5. Description of Facility Operations

Safety-Kleen Systems, Inc. (Safety-Kleen) began operation at the Facility in October 1979. Safety-Kleen provides mineral spirit solvent reclamation and supply service for customers primarily engaged in vehicle repair shops, industrial maintenance, and dry cleaning. The Facility provides customers with parts cleaning services, which involve parts degreasing units, consisting of a sink affixed to the top of a 16- or 30-gallon drum of cleaner solvent at the customer's location. The Facility also provides customers with aqueous-based parts washing solution and immersion cleaners (carburetor cleaner) for use in the degreasing units. The units are emptied and the hazardous materials are refilled by the Safety-Kleen truck operators at the customer's location, and the trucks transport the used materials back to the Facility. The hazardous waste solvents from the Facility are eventually transported to the Safety-Kleen's

Reedley Recycle Center or another permitted facility for recycling, treatment and/or disposal. The Facility stores, handles and transfers hazardous wastes in drums/containers and an underground storage tank as described in Part IV of this Permit. Please see Attachment B for the Facility's diagram.

The Permittee provides the following services which lead to the off-site generation of hazardous waste that the Permittee transports back to the Facility.

1. Petroleum-Based Cleaners (Mineral Spirits)
2. Aqueous-Based Parts Washing Solution
3. Safety-Kleen Immersion or Carburetor Cleaner Service
4. Safety-Kleen Dry Cleaner Service
5. Safety-Kleen Paint Collection Service
6. Safety-Kleen Used Oil Service
7. Safety-Kleen Used Antifreeze/Coolants Service
8. Miscellaneous Containerized Waste Services

6. Facility History

The Facility began operation as a Safety-Kleen, El Monte Branch in October 1979. Safety-Kleen expanded the El Monte Branch business to an accumulation center starting in August 1988. DTSC issued a hazardous waste facility permit to Safety-Kleen for the Facility on March 29, 1995 which expired on March 29, 2005.

7. Facility Size and Type for Fee Purposes

The Facility is categorized as a small facility pursuant to Health and Safety Code section 25205.1 and for purposes of Health and Safety Code sections 25205.2 and 25205.19.

PART III. GENERAL CONDITIONS

1. PERMIT APPLICATION DOCUMENTS

The Part "A" Application dated October 12, 2007 and the Part "B" Application (Operation Plan) dated February 24, 2006 are hereby made a part of this Permit by reference.

2. EFFECT OF PERMIT

- (a) The Permittee shall comply with the terms and conditions of this Permit and the provisions of the Health and Safety Code and California Code of Regulations (Cal. Code Regs.), title 22, division 4.5. The issuance of this Permit by DTSC does not release the Permittee from any liability or duty imposed by federal or state statutes or regulations or local ordinances, except the obligation to obtain this Permit. The Permittee shall obtain the permits required by other governmental agencies, including but not limited to, those required by the applicable land use planning, zoning, hazardous waste, air quality, water quality, and solid waste management laws for the construction and/or operation of the Facility.
- (b) The Permittee is permitted to store hazardous wastes in accordance with the terms and conditions of this Permit. Any management of hazardous wastes not specifically authorized in this Permit is strictly prohibited.
- (c) Compliance with the terms and conditions of this Permit does not constitute a defense to any action brought under any other law governing protection of public health or the environment, including, but not limited to, one brought for any imminent and substantial endangerment to human health or the environment.
- (d) DTSC's issuance of this Permit does not prevent DTSC from adopting or amending regulations that impose additional or more stringent requirements than those in existence at the time this Permit is issued and does not prevent the enforcement of these requirements against the Permittee.
- (e) Failure to comply with any term or condition set forth in the Permit in the time or manner specified herein will subject the Permittee to possible enforcement action including but not limited to penalties pursuant to Health and Safety Code section 25187.

- (f) Failure to submit any information required in connection with the Permit, or falsification and/or misrepresentation of any submitted information, is grounds for revocation of this Permit (Cal. Code Regs., tit. 22, §66270.43).
- (g) In case of conflicts between the Operation Plan and the Permit, the Permit conditions take precedence.
- (h) This Permit includes and incorporates by reference any conditions of waste discharge requirements issued to the Facility by the State Water Resources Control Board or any of the California Regional Water Quality Control Boards and any conditions imposed pursuant to section 13227 of the Water Code.

3. COMPLIANCE WITH CALIFORNIA ENVIRONMENTAL QUALITY ACT (CEQA)

A Notice of Exemption has been prepared in accordance with the requirements of Public Resources Code section 21000 et seq. and the CEQA Guidelines, California Code of Regulations, title 14, section 15061(b)(3).

4. ENVIRONMENTAL MONITORING

The Permittee shall comply with the applicable environmental monitoring and response program requirements of California Code of Regulations, title 22, division 4.5, chapter 14, articles 6 and 17.

5. ANNUAL HAZARDOUS WASTE REDUCTION AND MINIMIZATION CERTIFICATION

The Permittee shall certify annually that it has a hazardous waste reduction and minimization program and method in place and shall keep the annual certification as part of its Operating Record in accordance with California Code of Regulations, title 22, section 66264.73(b)(9).

6. ACCESS

- a) DTSC, its contractors, employees, agents, and/or any United State Environmental Protection Agency representatives are authorized to enter and freely move about the Facility for the purposes of interviewing Facility personnel and contractors; inspecting records, operating logs, and contracts relating to the Facility; reviewing progress of the Permittee in carrying out the terms of Part VI of the Permit; conducting such testing,

sampling, or monitoring as DTSC deems necessary; using a camera, sound recording, or other documentary-type equipment; verifying the reports and data submitted to DTSC by the Permittee; or confirming any other aspect of compliance with this Permit, Health and Safety Code, division 20, chapter 6.5, and California Code of Regulations, title 22, division 4.5. The Permittee shall provide DTSC and its representatives access at all reasonable times to the Facility and any other property to which access is required for implementation of any provision of this Permit, Health and Safety Code, division 20, chapter 6.5, and California Code of Regulations, title 22, division 4.5, and shall allow such persons to inspect and copy all records, files, photographs, documents, including all sampling and monitoring data, that pertain to work undertaken pursuant to the entire Permit or undertake any other activity necessary to determine compliance with applicable requirements.

- (b) Nothing in this Permit shall limit or otherwise affect DTSC's right to access and entry pursuant to any applicable State or federal laws and regulations.

DRAFT

PART IV. PERMITTED UNITS AND ACTIVITIES

This Permit authorizes operation only of the facility units and activities listed below. The Permittee shall not treat, store or otherwise manage hazardous waste in any unit other than those specified in this Part IV. Any modifications to a unit or activity authorized by this Permit require the written approval of DTSC in accordance with the permit modification procedures set forth in California Code of Regulations, title 22, division 4.5.

Unit 1:

Underground Storage Tank and Return and Fill Unit

Location:

North side of the Facility, inside of "Unit B" as shown in Figure 2 of the Operation Plan

Activity Type:

This Unit is for storage of hazardous waste.

Activity Description:

Either petroleum-based cleaners or aqueous-based parts washing solutions are stored in the Underground Storage Tank. Drums/containers holding either petroleum-based cleaners or aqueous-based parts washing solutions are received from Safety-Kleen customers and other Safety-Kleen facilities and unloaded in the Return and Fill Unit. The Return and Fill Unit is an ancillary unit for the Underground Storage Tank. At the Return and Fill Unit, two above-ground Drum Washers are used to empty and rinse drums/containers that contain either petroleum-based cleaners or aqueous-based parts washing solutions. The Drum Washers are connected to the Underground Storage Tank by above-ground and below-ground piping. Used oil and anti-freeze in drums/containers are also held up to 24 hours in the Return and Fill Unit for bulking purposes.

Physical Description:

This Unit is comprised of a 12,000-gallon (10' in diameter cylindrical with flat ends) double-walled steel and fiberglass-coated Underground Storage Tank with double-walled piping connecting it to the Return and Fill Unit.

The Return and Fill Unit includes two above-ground Drum Washers. Each Drum Washer has a capacity of 155 gallons and can process approximately 50 gallons of either petroleum-based cleaners or aqueous-based parts washing solutions per minute.

Each of the two steel-fabricated Drum Washers is approximately 6 feet wide by 3 feet deep, with a front height of approximately 5 feet. Either petroleum-based cleaners or aqueous-based parts washing solutions are poured from the drum/container into a Drum Washer which is designed to remove coarse solids and metal parts that may come in with either petroleum-based cleaners or aqueous-based parts washing solutions and to remove any remaining wastes from the drum/container. The liquid petroleum-based cleaners or aqueous-based parts washing solutions flow through a metal screen into the catch basin and then into the Underground Storage Tank.

The drum/container is then inverted and placed diagonally over the brushes of the Drum Washer. The Drum Washer is turned on and two streams of either petroleum-based cleaners or aqueous-based parts washing solutions are pumped from the catch basin and sprayed from two nozzles to rinse the drum/container. One nozzle sprays the outside of the drum/container and the other nozzle sprays the inside. There are ten containment pans (eight of them are approximately 6"H x 30"W x 9'L, and two of them are approximately 6"H x 41"W x 9'L) underneath the Drum Washers that serve as collection pans for the 155-gallon catch basins. After drums/containers are emptied in the Drum Washer, they are situated upside down on top of the Drum Washer for approximately one minute for drying. The drums/containers will then be externally wiped as needed and to be used for refill with products.

Maximum Capacity:

12,000 gallons for the Underground Storage Tank

Waste Types:

Petroleum-based cleaners, aqueous-based parts washing solutions, Used Oil, and Anti-freeze

RCRA Hazardous Waste Codes:

D001, D004, D005, D006, D007, D008, D009, D010, D011, D018, D019, D021, D022, D023, D024, D025, D026, D027, D028, D029, D030, D032, D033, D034, D035, D036, D037, D038, D039, D040, D041, D042, D043, and California Waste Codes Number 123, 132, 134, 135, 211, 212, 213, 251, 252, 342, 343, 741

Unit Specific Conditions:

1. The Underground Storage Tank shall be recertified for tank system integrity by an independent professional engineer registered in the State of California pursuant to California Code of Regulations, title 22, section 66264.191 no later than September, 2010, and every three years thereafter. The latest certification was completed in September 2007.
2. The drums/containers must be "empty" as that term is defined in California Code of Regulations, title 22, section 66261.7(b) before they exit this Unit. Any drum/container that meets the "empty" definition and standard in section 66261.7(b) is no longer subject to hazardous waste regulations.
3. The Permittee may only use either petroleum-based cleaners or aqueous-based parts washing solutions from the Drum Washer catch basin to spray and rinse the drums/containers that held petroleum-based cleaners or aqueous-based parts washing solutions, respectively. The Permittee may further spray or rinse an empty drum/container with virgin or recycled petroleum-based cleaners or aqueous-based parts washing solutions; on such occasions, the Permittee may deposit the rinsate into the Drum Washer prior to moving the drum from the Unit for refilling.
4. The Permittee shall keep the lid of any of the two Drum Washers tightly closed at all times when the Drum Washer is not in use.
5. The Permittee shall not store petroleum-based cleaners or aqueous-based parts washing solutions in the Underground Storage Tank in excess of one year from the date such hazardous waste arrives at the Facility. The Permittee shall not store either petroleum-based cleaners or aqueous-based parts washing solutions in this Unit, outside the Underground Storage Tank, in excess of 24 hours. The Permittee shall not hold used oil or anti-freeze in the Return and Fill Unit in excess of 24 hours.
6. Prior to using this Unit for petroleum-based cleaners, the Permittee shall obtain a permit from South Coast Air Quality Management District (SCAQMD) to authorize the operation. The Permittee shall send a copy of the SCAQMD permit to DTSC for review. The Permittee shall not use this Unit to store any petroleum-based cleaners until the Permittee receives written acknowledgement from DTSC that DTSC has reviewed and accepted the SCAQMD permit.

Air Emission Standards:

This Unit does not currently contain liquids with more than 500 ppmw of organic liquids and is not subject to the applicable requirements of California Code of Regulations, title 22, chapter 14, article 28.5. The Permittee shall comply with the applicable requirements of California Code of Regulations, title 22, chapter 14, article 28.5 and conduct daily inspections if and when the Permittee starts using this Unit to store petroleum-based cleaners.

Unit 2:

Drum/container Storage Area A

Location:

North portion of the building located on northwest side of the Facility, inside of "Unit A" as shown in Figure 2 of the Operation Plan

Activity Type:

This Unit is for storage of hazardous waste held in drums/containers.

Activity Description:

Storage of containerized hazardous waste inside a building and within a secondary containment area.

Physical Description:

Drums/containers holding hazardous waste are stored on pallets within the secondary containment area. The area is 34.5' long by 20.4' wide. The floor is concrete with a chemical-resistant coating surrounded by a 6" wide by 3.5" high concrete curb. The containment area occupies approximately 704 square feet. The curbed area contains two sumps to collect any potential spills of hazardous waste. The total capacity of the two sumps is 628 gallons.

Maximum Storage Capacity:

6,280 gallons

Waste Types:

Aqueous-based parts washing solvents, used oil, and anti-freeze

California and RCRA Hazardous Waste Codes:

D039, and California Waste Code Numbers 133, 134, 221, 222, 223, 342, 343, 352.

Air Emission Standards:

This Unit does not currently contain liquids with more than 500 ppmw of organic liquids and is not subject to the applicable requirements of California Code of Regulations, title 22, chapter 14, article 28.5.

Unit 3:

Drum/container Storage Area C1

Location:

Northeast side of the Facility

Activity Type:

This Unit is for storage of hazardous waste held in drums/containers.

Activity Description:

Storage of containerized hazardous waste inside a building and within a secondary containment area.

Physical Description:

Drums/containers holding hazardous waste are stored on pallets within the secondary containment area. The area is 77.9' long by 71.3' wide. The floor is concrete with a chemical-resistant coating surrounded by a 6" wide by 3.5" high concrete curb. The containment area occupies approximately 5,555 square feet. The curbed area contains four sumps to collect any potential spills of hazardous waste. The total capacity of the four sumps is 1,907 gallons.

Maximum Storage Capacity:

19,050 gallons

Waste Types:

Paint Thinners, Paint Wastes, Used Oil, Anti-Freeze, Immersion Cleaner, Dry Cleaning

Solvents, Spent Parts Washer Solvents (Mineral Spirits and Aqueous-Based Parts Washing Solvents), Industrial Solvents, Drum Washer Bottom Sediments, Tank Bottom Sediments, and miscellaneous Fluid Recovery System waste

California and RCRA Hazardous Waste Codes:

D001, D002, D004, D005, D006, D007, D008, D009, D010, D011, D018, D019, D021, D022, D023, D024, D025, D026, D027, D028, D029, D030, D032, D033, D034, D035, D036, D037, D038, D039, D040, D041, D042, D043, F001, F002, F003, F004, F005 and California Waste Codes Number 123, 132, 133, 134, 135, 211, 212, 213, 214, 221, 222, 223, 241, 251, 252, 331, 342, 343, 352, 461, 491, 741, and 751.

UNIT-SPECIFIC SPECIAL CONDITIONS:

The Permittee shall not open any drums or containers holding paint thinners, paint wastes, used oil, anti freeze, or dry cleaning solvents in this Unit for any purpose.

Air Emission Standards:

This Unit contains liquids with vapor pressure more than 5.2 KPa and organic liquids above 500 ppmw and is subject to the requirements of California Code of Regulations, title 22, chapter 14, article 28.5. Daily inspections are required.

Unit 4:

Drum/container Storage Area C2

Location:

West of Unit C1

Activity Type:

This Unit is for storage of hazardous waste held in drums/containers.

Activity Description:

Storage of containerized hazardous waste inside a building and within a secondary containment area.

Physical Description:

Drums/containers holding hazardous waste are stored on pallets within the secondary

containment area. The area is 45.4' long by 27.9' wide. The floor is concrete with a chemical-resistant coating surrounded by a 6" wide by 3.5" high concrete curb. The containment area occupies approximately 1,267 square feet. The curbed area contains one sump to collect any potential spills of hazardous waste. The total capacity of the sump is 456 gallons.

Maximum Storage Capacity:

4,560 gallons

Waste Types:

Paint Thinners, Paint Wastes, Used Oil, Anti-Freeze, Immersion Cleaner, Dry Cleaning Solvents, Spent Parts Washer Solvents (Mineral Spirits and Aqueous-Based Parts Washing Solvents), Industrial Solvents, Drum Washer Bottom Sediments, Tank Bottom Sediments, and miscellaneous Fluid recovery System waste

California and RCRA Hazardous Waste Codes:

D001, D002, D004, D005, D006, D007, D008, D009, D010, D011, D018, D019, D021, D022, D023, D024, D025, D026, D027, D028, D029, D030, D032, D033, D034, D035, D036, D037, D038, D039, D040, D041, D042, D043, F001, F002, F003, F004, F005 and California Waste Codes Number 123, 132, 133, 134, 135, 211, 212, 213, 214, 221, 222, 223, 241, 251, 252, 331, 342, 343, 352, 461, 491, 741, and 751.

UNIT-SPECIFIC SPECIAL CONDITIONS:

The Permittee shall not open any drums or containers holding paint thinners, paint wastes, used oil, anti freeze, or dry cleaning solvents in this Unit for any purpose.

Air Emission Standards:

This Unit contains liquids with vapor pressure more than 5.2 KPa and organic liquids above 500 ppmw and is subject to the requirements of California Code of Regulations, title 22, chapter 14, article 28.5. Daily inspections are required.

Unit 5:

Drum/container Storage Area D

Location:

Southeast side of the Facility.

Activity Type:

This Unit is for storage of hazardous waste held in drums/containers.

Activity Description:

Storage of containerized hazardous waste inside a building and within a secondary containment area.

Physical Description:

Drums/containers holding hazardous waste are stored on pallets within the secondary containment area. The area is 48' long by 43.5' wide. The secondary containment in this unit is provided by concrete floor with a chemical-resistant coating, a perimeter curb and two access ramps. The minimum height of the ramps or perimeter curb is 6". The gross containment volume is 1,044 cubic feet. Each ramp is 8' long by 10' wide, with a half-height of 0.25'.

Maximum Storage Capacity:

6,750 gallons

Waste Types:

Paint Thinners, Paint Wastes, Used Oil, Anti-Freeze, Immersion Cleaner, Dry Cleaning Solvents, Spent Parts Washer Solvents (Mineral Spirits and Aqueous-Based Parts Washing Solvents), Industrial Solvents, Drum Washer Bottom Sediments, Tank Bottom Sediments, and Miscellaneous Fluid Recovery System Waste

California and RCRA Hazardous Waste Codes:

D001, D002, D004, D005, D006, D007, D008, D009, D010, D011, D018, D019, D021, D022, D023, D024, D025, D026, D027, D028, D029, D030, D032, D033, D034, D035, D036, D037, D038, D039, D040, D041, D042, D043, F001, F002, F003, F004, F005 and California Waste Codes Number 123, 132, 133, 134, 135, 211, 212, 213, 214, 221, 222, 223, 241, 251, 252, 331, 342, 343, 352, 461, 491, 741, and 751.

UNIT-SPECIFIC SPECIAL CONDITIONS:

The Permittee shall not open any drums or containers holding paint thinners, paint wastes, used oil, anti freeze, or dry cleaning solvents in this Unit for any purpose.

Air Emission Standards:

This Unit contains liquids with vapor pressure more than 5.2 KPa and organic liquids above 500 ppmw and is subject to the requirements of California Code of Regulations, title 22, chapter 14, article 28.5. Daily inspections are required.

DRAFT

PART V. SPECIAL CONDITIONS

1. The Permittee is prohibited from conducting any hazardous waste transfer, storage, treatment or other management activity unless it is specifically described in this Permit.
2. The Permittee shall take all measures necessary to prevent any spills of hazardous waste into the drainage systems.
3. Unless as otherwise specified in this Permit, the Permittee shall not store hazardous waste in any of the permitted storage units in excess of one year from the date such hazardous waste arrives at the Facility.
4. For the purposes of calculating the permitted capacity or volume for storage and for secondary containment, all hazardous waste that is stored or located in a permitted unit shall be included in the volume calculations for that unit, including any hazardous waste that is covered by the Transfer Facility Exemption under California Code of Regulations, title 22, section 66263.18.
5. Truck-to-truck transfer operations that are covered by the Transfer Facility Exemption under California Code of Regulations, title 22, section 66263.18 may be conducted only in the Truck Loading Area located next to the Drum/Container Storage Area C1 inside of the building, as shown in Figure 2 of the Operation Plan. No containers or drums holding hazardous waste shall be held outside of any truck for more than 24 hours in this Truck Loading Area.
6. The Permittee shall not be designated as the Treatment, Storage or Disposal Facility on the manifests for any exempt transfer activities conducted pursuant to California Code of Regulations, title 22, section 66263.18.
7. Drums or containers of hazardous waste shall be stored on pallets and shall not be stacked more than six feet high.
8. Any drum/container that previously held hazardous waste and is not "empty" as that term is defined in California Code of Regulations, title 22, section 66261.7(b) shall be managed as a hazardous waste.

PART VI. CORRECTIVE ACTION



1. In the event the Permittee identifies an immediate or potential threat to human health and/or the environment, discovers new releases of hazardous waste and/or hazardous constituents, or discovers new Solid Waste Management Units (SWMUs) not previously identified, the Permittee shall notify DTSC orally within 24 hours of discovery and notify DTSC in writing within 10 days of such discovery summarizing the findings including the immediacy and magnitude of any potential threat to human health and/or the environment.
2. DTSC may require the Permittee to investigate, mitigate and/or take other applicable action to address any immediate or potential threats to human health and/or the environment and newly identified SWMUs or releases of hazardous waste and/or hazardous constituents. If and when corrective action is required at the Facility, the Permittee shall conduct corrective action under either a Corrective Action Consent Agreement or an Enforcement Order for Corrective Action issued by DTSC pursuant to Health and Safety Code sections 25187 and 25200.10.
3. To the extent that work being performed pursuant to Part VI of the Permit must be done on property not owned or controlled by the Permittee, the Permittee shall use its best efforts to obtain access agreements necessary to complete work required by this Part of the Permit from the present owner(s) of such property within 30 days of approval of any workplan for which access is required. "Best efforts" as used in this paragraph shall include, at a minimum, a certified letter from the Permittee to the present owner(s) of such property requesting access agreement(s) to allow the Permittee and DTSC and its authorized representatives access to such property and the payment of reasonable sums of money in consideration of granting access. The Permittee shall provide DTSC with a copy of any access agreement(s). In the event that agreements for the access are not obtained within 30 days of approval of any workplan for which access is required, or of the date that the need for access becomes known to the Permittee, the Permittee shall notify DTSC in writing within 14 days thereafter regarding both efforts undertaken to obtain access and its failure to obtain such agreements. In the event DTSC obtains access, the Permittee shall undertake approved work on such property. If there is any conflict between this permit condition on access and the access requirements in any agreement entered into between DTSC and the Permittee, this permit condition on access shall govern.

4. Nothing in Part VI of the Permit shall be construed to limit or otherwise affect the Permittee's liability and obligation to perform corrective action including corrective action beyond the facility boundary, notwithstanding the lack of access. DTSC may determine that additional on-site measures must be taken to address releases beyond the Facility boundary if access to off-site areas cannot be obtained.

DRAFT

ATTACHMENT B

DRAFT

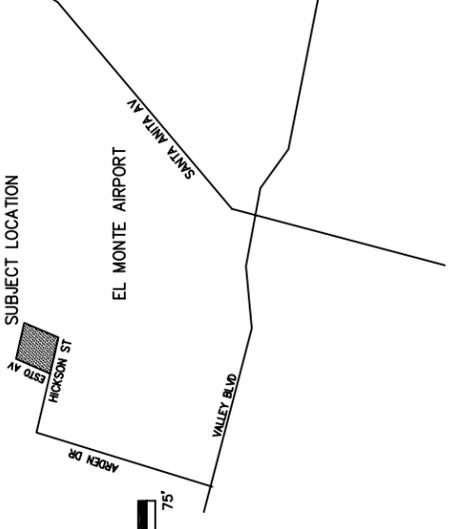

VICINITY MAP
NOT TO SCALE



WASTE STORAGE AREA

GENERAL NOTES

1. SWMU'S : UNITS A,B,C1,C2,D, & UST'S.

PROPRIETARY STATEMENT

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF SAFETY-KLEEN CORP. AND IS PROPRIETARY AND CONFIDENTIAL INFORMATION. THIS DRAWING AND THE INFORMATION CONTAINED THEREIN MUST NOT BE DUPLICATED, USED, DIVULGED, REPRODUCED, COPIED, DISCLOSED OR APPROPRIATED IN WHOLE OR IN PART FOR ANY PURPOSE, OTHER THAN AS EXPRESSLY AUTHORIZED BY SAFETY-KLEEN CORP. THIS DRAWING MUST BE RETURNED PROMPTLY UPON REQUEST.



| NO. | DESCRIPTION | BY | CHK | APPR | DATE |
|-----|---|-----|-----|------|----------|
| 07 | ADD OUTDOOR SPILL CONTAINMENT AREAS | JEK | SL | SL | 07-18-07 |
| 06 | I.D. WASTE STORAGE AREAS | JEK | | | 08-28-08 |
| 05 | SHOW 25' SETBACK LINE, PROPANE TANK & HOUSEHOLD HAZARDOUS WASTE STORAGE AREA | MEY | | | 08-15-07 |
| 04 | SHOW NEW 12,000 GALLON UST FOR 150 SOLVENT. | MEY | | | 08-14-05 |
| 03 | REMOVE OLD TWO BAY SHELTER AND UNDERGROUND TANKS. SHOW PROPOSED CYPRESS TREE SEPARATION | MEY | | | 12-9-04 |
| 02 | REVERSE SITE PLAN TO EMPHASIZE USE PERMIT APPLICATION FOR ADJOINING BUILDING | MEY | | | 5-11-03 |
| 01 | SHOW NEW WROUGHT IRON FENCE, INSIDE R&F AND PARKING SCHEMATIC. | MEY | | | 8-17-02 |
| 00 | REVISED S.K. DWG. 70806F-0001-00 TO REFLECT PROPOSED RETURN & FILL DOCK | AU | | | 2-13-02 |
| | | | | | |

TITLE
SITE PLAN
10625 HICKSON STREET

SAFETY-KLEEN SYSTEMS, INC.
5400 LEGACY DR. CLUSTER III, BLDG. 3, PLANO, TX.
PHONE 800-668-5740

SCALE: 1"=20'-0"
BY: MEY/ALI
CHKD: P.E. APPR
DATE: 7-13-92
BRANCH LOCATION: EL MONTE, CA
STD-DWG-REV NO.: 7118-SP00-001

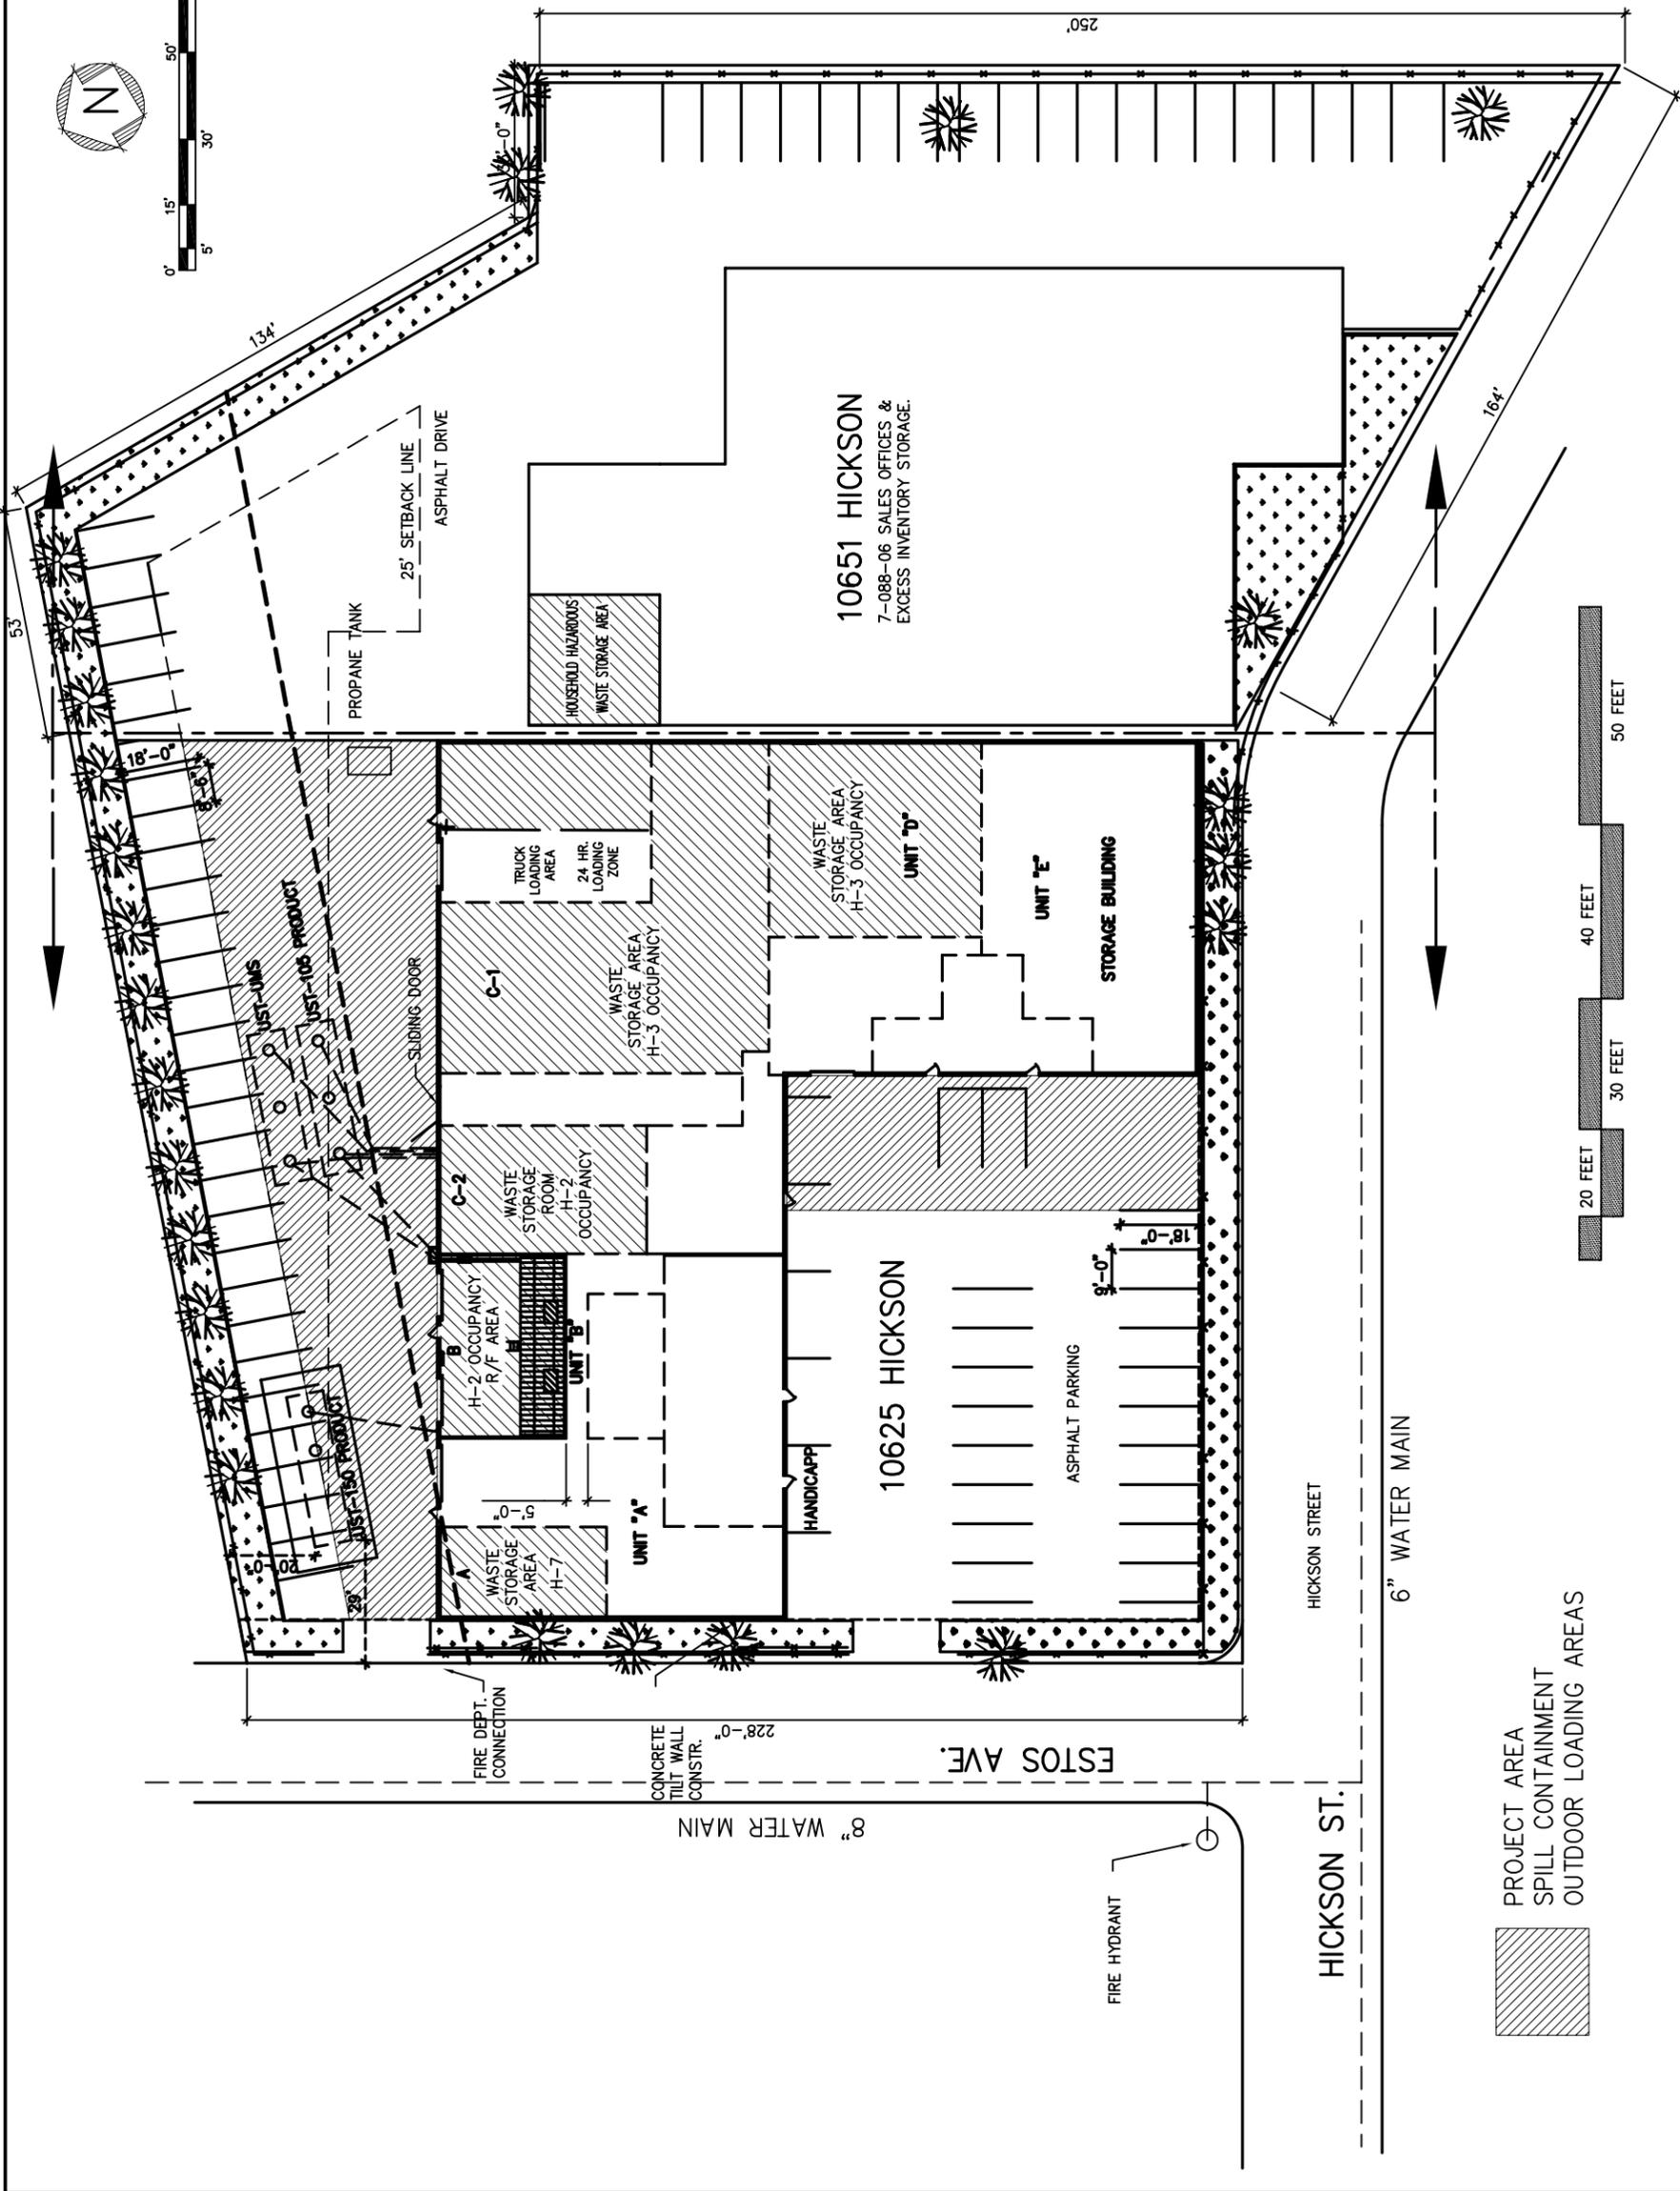


FIGURE 2

PLOT DATE: 11-16-97